

PV Output Power Fluctuations Smoothing and Optimum Capacity of Energy Storage System for PV Power Generator

Tomonobu Senjyu¹, Manoj Datta¹, Atsushi Yona¹, Toshihisa Funabashi², and Chul-Hwan Kim³

¹ Department of Electrical and Electronics Engineering
University of the Ryukyus, 1 senbaru Nishihara-cho Nakagami, Okinawa 903-0213, Japan
Phone: +81988958686, E-mail: b985542@tec.u-ryukyu.ac.jp, k068472@eve.u-ryukyu.ac.jp

² Meidensha Corporation, ThinkPark Tower, 2-1-1 Osaki,
Shinagawa-ku, Tokyo 141-6029, Japan
Phone: +810364207208, E-mail: funabashi-t@mb.meidensha.co.jp

³ School of Electrical and Computer Engineering,
Sungkyunkwan University, Suwon City 440-746, Korea
E-mail: chkimskku@yahoo.com

Abstract. In this paper, an Energy Storage System (ESS) based control method is proposed to reduce the PV output power fluctuations, which in turn will reduce the frequency deviations of the power system introduced by large penetration of PV power. The ESS control model introduced here will maintain the energy storage ratio of the ESS near 50%. This will increase the life time of the ESS as well as will decrease the maintenance cost of the ESS. A local search algorithm is also provided with this ESS control model to search the optimal capacity of the ESS required for smoothing the PV output power fluctuations and to find the minimum capital cost. A cost comparison is shown to realize the performance of the search algorithm.

Key words

Capital cost, Energy Storage System, Optimal capacity, PV output power smoothing.

1. Introduction

In recent times, Global warming is a burning issue as the CO_2 density increased highly in the atmosphere. Therefore, clean and renewable energy sources must be introduced to reduce the CO_2 density. Among various renewable energy systems, PV systems are expected to play a promising role as a clean power electricity source in meeting future electricity demands. However, the power output of PV systems fluctuates depending on weather conditions, season, and geographic location. In the future, when a significant number of PV systems will be connected to the grids of power utilities, power output fluctuation may cause problems like voltage fluctuation and large frequency deviation in electric power system operation [1]-[3]. Therefore, for the penetration of large PV system's output power in the utility without reduction of the reliability of utility power systems, suitable measures must be applied to the PV systems side.

On the PV system side, energy storage devices like batteries can be used as smoothing devices for a PV system's output. There have been investigations aimed at improving the performance of PV systems equipped with batteries [4]-[9]. However, energy storage device

increases capital cost, as it needs maintenance. The maintenance cost mainly depends on charge/discharge action of battery. Therefore, controlling the charge/discharge action along with maintaining the energy storage ratio near 50% is a issue need to be addressed. Besides, optimal capacity and minimum capital cost of the ESS needed to reduce the PV output power fluctuations should also be investigated. However, in previous investigations, the optimal size of battery and battery parameters for charge/discharge action are not considered.

In this paper, to address the above given issue, a control methodology for ESS along with PV generator is presented, which will maintain storage energy ratio of the battery up to 50% and will select optimal size of the battery needed for smoothing PV output power fluctuations. From the simulation results, it has been found that the proposed method works well to reduce the PV output power fluctuations and also selects the optimal ESS capacity needed for it maintaining the energy storage ratio near 50%.

2. Small Power System

The concept of small power utility in this paper is shown in Fig. 1. The small power utility consists of the diesel generators and PV systems equipped with ESS that generate power to supply the demand. In addition, it is assumed that the small power utility is not connected to large power utility and it is always operated independently like the power system in an isolated island. The small power system model which consists of diesel generator in detail, PV power generation system, load and Energy Storage system, and load is shown in Fig. 2 where S_i is the insolation, P_{max}^* is the maximum power

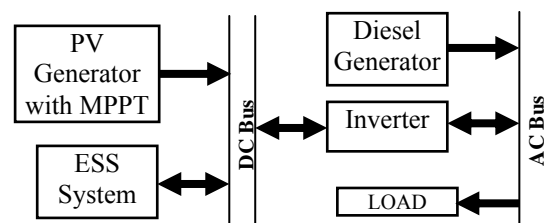


Fig. 1. Small power utility.

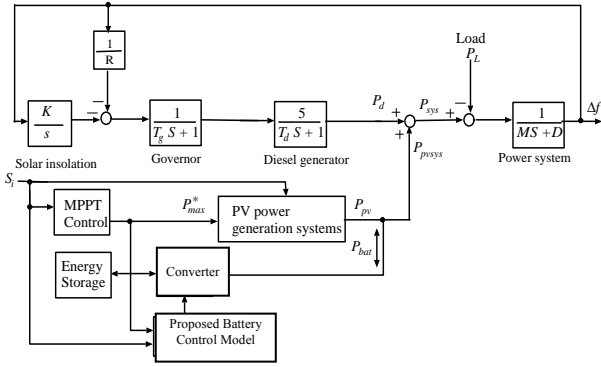


Fig. 2. Small power system model.

point tracking (MPPT) command power, P_{bat} is the battery power, P_{pvsys} is the PV power by PV supplied to the power system, P_d is generated power by diesel generators, R is the speed regulation, T_g is the governor time constant, T_d is the diesel generator time constant, P_L is the load, M is the inertia constant, D is the damping constant, u is the input to the governor, Δf is the frequency deviation of small power utility.

The control algorithm [10] for the inverter shown in Fig. 1 adopted here is very simple. The inverter output voltages and currents are sensed and transformed from 3-phase to synchronously rotating 2-phase. The command currents are generated dividing the output power command by sensed inverter voltage. Then the error between command inverter current and actual inverter current is processed through a PI controller to generate the PWM pulses. For maximum power extraction, the output power command is generated by maximum power point tracking algorithm. For simple structure and less costly implementation, a Perturbed and Observed (P&O) [11] algorithm was chosen in the present structure.

As the design of power converter and the control system is significantly influenced by the solar module characteristics, these will be briefly reviewed here. The solar module is a nonlinear device and can be represented as a current source model, as shown in Fig. 3. The traditional $I-V$ characteristics of a solar module are given by the following equation [12]:

$$I_0 = N_p N_s I_g I_{sat} \left\{ \exp \frac{qV_0}{AKT_a} \left(V_0 + \frac{N_s R_s I_0}{N_p} \right) - 1 \right\} - I_{rsh} \quad (1)$$

where I_0 and V_0 are the output current and output voltage of the solar module, respectively, I_g is the generated current under a given insolation, I_{sat} is the reverse saturation current, q is the charge of an electron, K is the Boltzmann's constant, A is the ideality factor, T_a is the temperature (K), N_p is the number of cells in parallel, N_s is the number of cells in series, R_s is the internal series resistance, and I_{rsh} is the current due to intrinsic shunt resistance of the solar module.

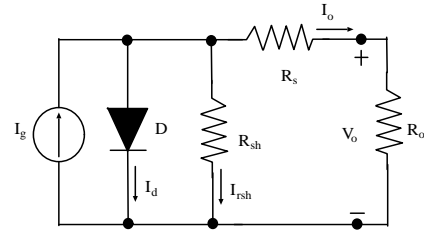


Fig. 3. Equivalent circuit of a solar module.

The solar module output power is given by the following equation:

$$P_0 = V_0 I_0 \quad (2)$$

Equations given in (1) and (2) are used in the development of computer simulations for the solar module. The MATLAB/SIMULINK is used. Fig. 4(a) and (b) shows the simulated ampere-volt and power-volt curves of the solar module for different insolation at constant temperature. Figs. 4(c) and (d) show the simulated ampere-volt and power-volt curves of the solar module for different temperature at constant insolation. From these curves, it is observed that the output characteristics of the solar module are nonlinear and vitally affected by the variation of insolation. However, variation of temperature slightly affects the output characteristics of solar module. Therefore, for the present case study, insolation and temperature variation effects both are taken in to account to model the solar array.

3. Battery Control Method

In order to smooth PV output power fluctuations, average PV power is generated from MPPT generated PV power through a low pass filter. The average PV power is given by the following equation

$$P_{avg} = P_{max} f(s) \quad (3)$$

$$\text{where } f(s) = \frac{0.9}{20s + 1}$$

This average power is used as command power for the battery control system. Therefore, this command power

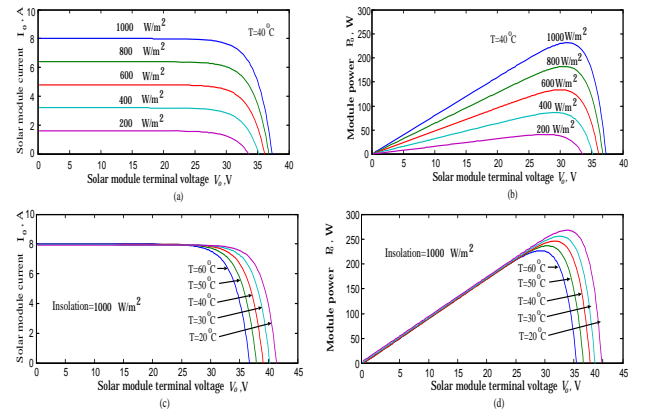


Fig. 4. Solar module characteristic curves. (a) and (c) Current-voltage curves. (b) and (d) Power-voltage curves. (For (a) and (b) temperature is constant; for (c) and (d) insolation is constant).

will be achieved from the PV system by charging/discharging action of the Battery. The proposed battery control model is shown in Fig. 5.

At first the proposed model calculates PV output power fluctuations by the given below equation.

$$\Delta P_{pvsys} = P_{avg} - P_{max} \quad (4)$$

where ΔP_{pvsys} is PV output power fluctuations. To reduce the charge/discharge action of the battery, a definite value for the dead zone D_{zone} is set. Dead zone will activate when ΔP_{pvsys} is greater than the dead zone value. Therefore, if the dead value is set big, small PV power fluctuations will remain in the system. On the other hand, if the dead zone value is set small, PV output power fluctuations will be smoothed well, however, battery will experience rapid charge/discharge action. So, choosing the optimal parameter for battery control system is a vital issue. From Fig. 5, it can be seen that correction power P_c is added with dead zone. Then, battery output P_{bat} is computed through the limiter whose maximum range is the converter capacity C_I . Battery experiences charge/discharge action when P_{bat} becomes positive/negative. The battery's remaining capacity W_{bat} is calculated through integration. This integrator is also considered as a limiter whose maximum range is the battery capacity C_{bat} . The remaining battery capacity W_{bat} is passed through a 2-D lookup table to maintain the storage ratio $\xi (= \frac{W_{bat}}{C_{bat}} 100\%)$ to near 50%.

The lookup table is shown in Fig. 6. The lookup table produces a correction value M . The product of correct value M and converter capacity C_I becomes the correct power P_c .

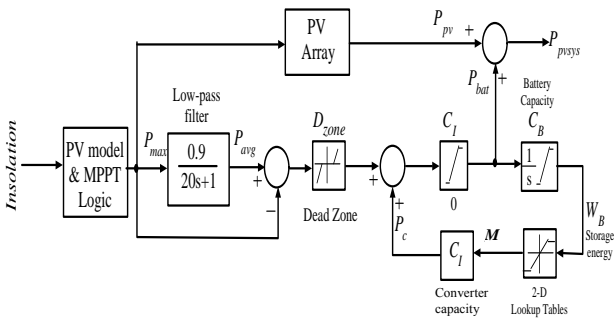


Fig. 5. Proposed battery control model.

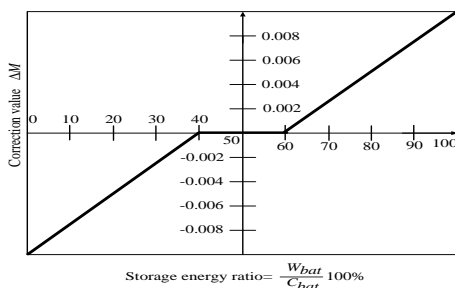


Fig. 6. Lookup table for correction value M .

4. Optimization of Battery Size and Cost

When searching the optimal size of the battery capacity and converter capacity, which will maintain minimum capital cost, optimal control parameters for battery control model should be searched. The searching algorithm is shown in Fig. 7.

Objective function and constraint condition are given in (5) and (6). Capital cost C_{cap} is calculated from (5). Here C_p is the per kWh capacity price of the battery and C_w is the per kW capacity of the converter [13].

$$\min C_{cap} = C_B C_p + C_I C_w \quad (5)$$

$$\Delta P_{pvsys \max} \geq \Delta P_{pvsys} \quad (6)$$

The searching process for optimization is described as follows.

Step 1: Maximum output power fluctuation tolerance limit $\Delta P_{pvsys \max}$ is set.

Step 2: In this steps control parameters of ESS (M , D_{zone}) are set.

Step 3: The charge/discharge action of battery is performed. ΔP_{pvsys} is calculated. It searches C_B and C_I to minimize the capital cost using the local search which is shown in Fig. 8.

This step increases by a large width when it searches for optimal battery and converter capacities. Secondly, it searches by small width of increase. As shown in Fig. 8, this process iterated twice according to objective function. In order to prevent the convergence in local solution, it searches solution of three higher ranks to minimize the capital cost.

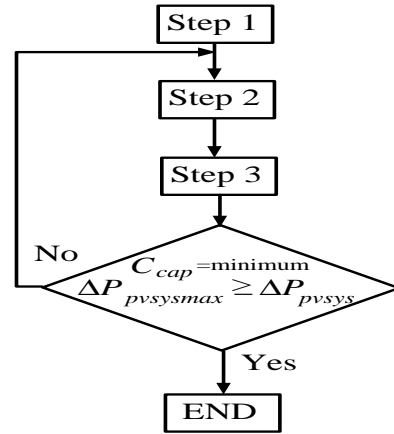


Fig. 7. Algorithm used for optimization .

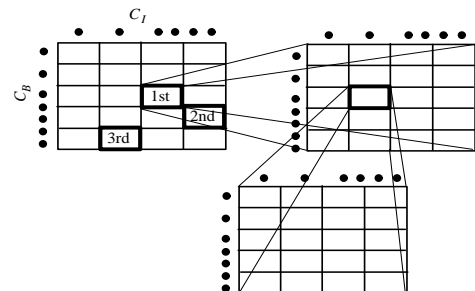


Fig. 8. Local search on step 3.

Step 4: The result of step 3 is evaluated. If it satisfies at end conditions, process terminated else it goes to step 2.

5. Simulation Results

In this paper, the effectiveness of output power leveling of PV array and frequency deviation reduction of power system using the proposed method is examined by simulation with system model and parameters as mentioned in [12]-[16]. In order to use parameters of real PV system given in [15], [16], the rated output power of the PV array is 241kW. Simulation parameters of power system, PV array, power converter and PI controller are shown in TABLE III. Here, integral time T is 100 s, sampling time T_s to obtain discrete value of output power command is 10 s, and sampling time of PI controller is 1 ms. Simulation time is 30 minutes and the averaging sample time of insolation is 20 s.

TABLE II shows the simulation results for the optimization algorithm.

TABLE I. Simulation Parameters

Parameters of small power system	
Inertia constant, M	0.150 puMW·s/Hz
Damping constant, D	0.008 puMW/Hz
Governor time constant, T_g	0.10 s
Time constant, T_t	0.25 s
Time constant, T_r	8.0 s
Speed regulation, R	2.5 Hz/puMW
Parameters of PV array	
Rated output power	241 kW
Open circuit voltage	588.80 V
Short circuit current	520.37 A
Number of modules in series	16
Number of modules in parallel	65
Total number of cells	62,400
Parameters of PV module	
Rated output power	231.58 W
Open circuit voltage, V_{oc}	36.30 V
Short circuit current, I_{sc}	7.99 A
Shunt resistance, R_{sh}	50 Ω
Series resistance, R_s	5 Ω
Ideality factor, A	1.450
Inverse Saturation Current, I_{or}	3.047e-07 A
S.C. current temperature constant, I_t	1.73e-03 A/ 0 K
Reference temperature, T_{ref}	25 0 C
Boltzman's constant, K	1.38e-23
Charge of an electron, q	1.602e-19 C
Bandgap voltage, E_g	1.11 eV
Number of cells in series, N_s	60
Standard insolation, S_i	1,000 W/m 2
Dimension	0.75 m 3

TABLE II. Optimization results

Sl.	Case 1	Case 2	Case 3	Case 4
ΔM	0.002	0.001	0.002	0.007
D_{zone}	0	0	0	0
ΔP_{pvsys}	± 34 kW	± 12 kW	± 11 kW	± 15 kW
C_B	60 kWh	160 kWh	180 kWh	200 kWh
C_I	130 kW	200 kW	170 kW	230 kW
Cost	237 k \$	249 k \$	381 k \$	485 k \$

The comparative simulation results of the proposed control and MPPT control [4] are shown in Fig. 9 by solid line and dotted line respectively. Insolation and load are shown in Figs. 9 (a) and (b) respectively. Fig 9 (c) shows the PV power produced by MPPT control and proposed control. From, Fig. 9 (c), it can be said that PV power produced by proposed method is levelled by battery charging/discharging action.

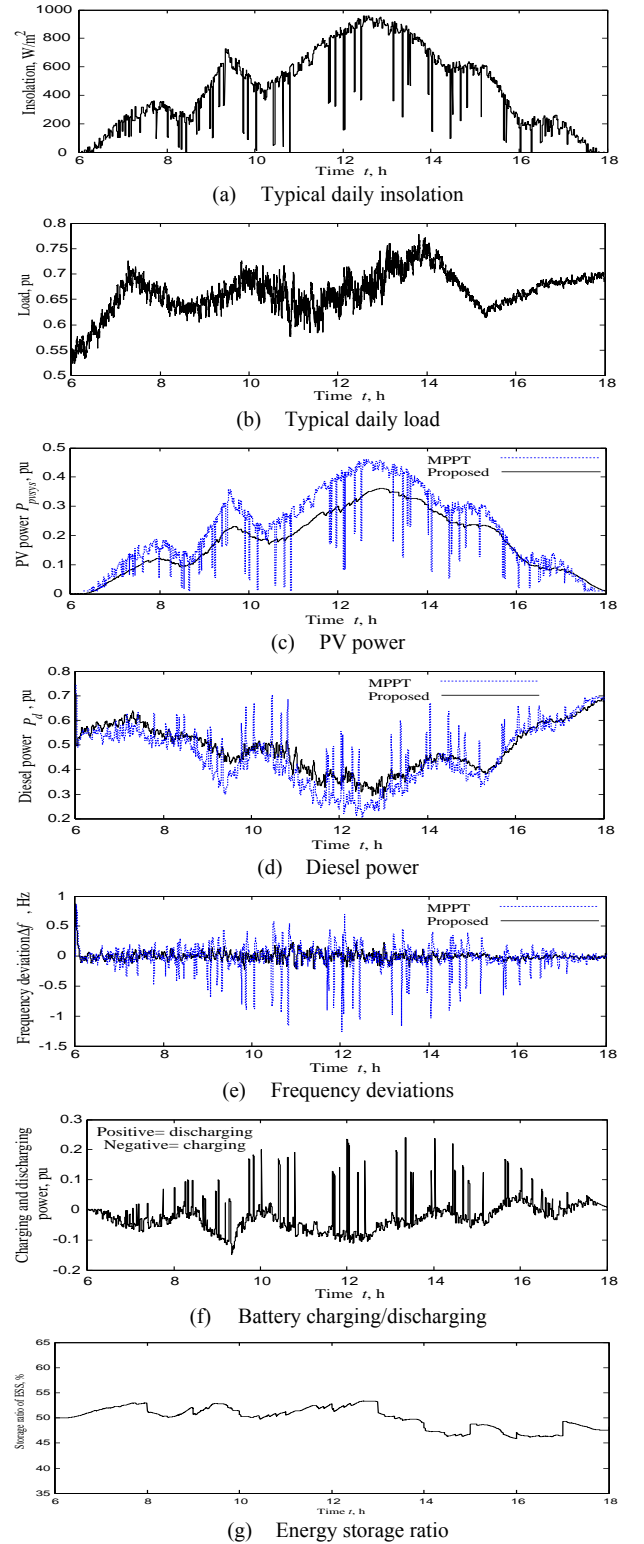


Fig. 9. Comparative simulation results of the proposed control and MPPT control

Fig. 9 (d) shows diesel power where diesel power produced by proposed method fluctuates less than the diesel power produced by MPPT control. Fig. 9 (e) shows the frequency deviations where frequency deviations produced by MPPT control are ± 1 Hz. On the other hand, frequency deviations produced by proposed method is almost near to zero. Therefore, it can be said that the proposed method is effective to reduce the frequency deviation of the utility. Fig. 9 (f) shows battery charging/discharging action. Fig. 9 (g) shows the storage energy ratio which is maintained below 50%, thus, it will reduce maintenance cost for the battery. So overall capital cost will be reduced as the optimum battery and converter capacity is used by the proposed method.

6. Conclusion

In this paper, PV output power fluctuations are levelled using the proposed methodology through battery charge/discharge action and the optimal size of the battery is calculated to minimize the capital cost. In the optimization problem of Energy Storage System (ESS), the control parameter for ESS is selected in all combinations and local search is performed to find the optimal size of the battery. The proposed method is compared with conventional MPPT. From the simulation results, it has been found that the proposed method is able to achieve the required control parameters for ESS and the optimal battery and converter capacities to minimize the total cost and to minimize the frequency deviations.

References

- [1] S. Yanagawa, T. Kato, K. Wu, A. Tabata, and Y. Suzuoki, "Evaluation of LFC capacity for output fluctuation of photovoltaic generation systems based on multi-point observation of insolation," in *Proc. IEEE Power Engineering Society Summer Meeting*, 2001, pp. 1652-1657.
- [2] A. Woyte, V.V. Thong, R. Belmans, and J. Nijs, "Voltage fluctuations on distribution level introduced by photovoltaic systems," *IEEE Trans. Energy Convers.*, vol. 21, no. 1, pp. 202-209, March 2006.
- [3] Y.T. Tan, D.S. Kirschen, and N. Jenkins, "A model of PV generation suitable for stability analysis," *IEEE Trans. Energy Convers.*, vol. 19, no. 4, pp. 748-755, Dec 2004.
- [4] T. Kinjo, T. Senjyu, N. Urasaki, and H. Fujita, "Output levelling of renewable energy by electric double layer capacitor applied for energy storage system," *IEEE Trans. Energy Convers.*, vol. 21, no.1, pp. 221- 227, March 2006.
- [5] Md. H. Rahman and S. Yamashiro, "Novel distributed power generating system of PV-ECaSS using solar energy estimation," *IEEE Trans. Energy Convers.*, vol. 22, no.2, pp. 358-367, June 2007.
- [6] J. P. Barton and D. G. Infield, "A probabilistic method for calculating the usefulness of a store with finite energy capacity for smoothing electricity generation from wind and solar power," *Journal of Power Sources.*, vol. 162, pp. 943-948, 2006.
- [7] R. Wanger, "Large lead/acid batteries for frequency regulation, load levelling and solar power applications," *Journal of Power Sources*, vo. 67, pp. 163-172, 1997.
- [8] H. Sugihara, S. Nishikawa, and Y. Kimura, "Observation of the hybrid system using photovoltaic and sodium-sulphur battery," in *Proc. JSES/JWEA Joint Conference*, 2001, pp. 13-16.
- [9] H. Miyauchi, K. Eguchi, and H. Hayashi, "SEMS to power quality improvement," in *Proc. IEEJ Conference of Power and Energy Society*, 2002, pp. 110-115.
- [10] K. Kobayashi, I. Tanako, and Y. Sawada, "A study of a two stage maximum power point tracking control of a photovoltaic system under partially shaded insolation conditions," *Solar Energy Materials & Solar Cells*, vol. 90, pp. 2975-2988, 2006.
- [11] N. Femia, G. Petrone, G. Spagnuolo, and M. Vitelli, "Optimization of perturb and observe maximum power point tracking method," *IEEE Trans. Power Electron.*, vol. 20, no. 4, pp. 963-973, July 2006.
- [12] C. Hua, J. Lin, and C. Shen, "Implementation of a DSP controlled photovoltaic system with peak power tracking," *IEEE Trans. Ind. Electron.*, vol. 45, no. 1, pp. 99-107, Feb. 1998.
- [13] [Online]. Available: <http://www.electricitystoarge.com>
- [14] T. Senjyu, T. Kaneko, A. Yona, N. Urasaki, T. Funabashi, F. Yamada, and S. Sugimoto, "Output power control for large wind power penetration in small power system," in *Proc. IEEE PES General Meeting*, sessionwindpower, CD-ROM, 2007.
- [15] [Online]. Available: <http://www.powerlight.com/success/pdf/LVVWDRonzoneReservoir.pdf>
- [16] [Online]. Available: <http://www.xantrex.com/web/id/214/p/1840/pt/23/product.asp>