

Design and Implementation of an Efficient Hybrid System for Electricity Production

Luís P. M. Fernandes*, João M. G. Figueiredo**

*IPP-ESTG, Portalegre, CEM Mechatronics Group University of Évora, Portugal, lpedro@estgp.pt

** CEM Mechatronics Group University of Évora, Portugal, IDMEC-IST – Technical University Lisbon, Portugal, jfig@uevora.pt

Abstract. This paper aims to develop a new method for the economical evaluation of Hybrid Systems for electricity production. The different types of renewable sources are specifically evaluated in the economical performance of the overall equipment. The presented methodology was applied to evaluate the design of a photovoltaic-wind-diesel hybrid system to produce electricity for a community in the neighbourhood of Luanda, Angola.

Keywords

Hybrid systems, solar energy, wind energy, rural electrification

1. Introduction

The intensive consumption of fossil combustibles is the main cause for the negative impact on our atmosphere. In fact, the fossil combustibles are the main energetic source that sustains the worldwide development. Both major world energetic necessities on thermal and mechanical power are mainly delivered by fossil combustibles.

Today, due to the increasing international concern on the Earth climatic changes we are assisting to an intense research on alternative energetic sources. Among these sources the renewable energies are strongly motivating the research community. This paper focus on two renewable sources: wind power and solar photovoltaic (PV). Both these energetic sources are clean and worldwide available. The comparative advantages of these energetic sources in relation to other renewable energies are demonstrated by the intense expansion of both wind and photovoltaic (PV) production plants, mainly in the industrialized world. This expansion is not due to direct exploration costs but mainly motivated by its reduced impact on environment. However, these renewable resources are extremely useful in low-developed countries, with small needs on electricity and low density populations, where small communities are distributed along great geographical extensions.

The coverage of long distances by electric distribution networks are extremely expensive and completely away from the economical budget of poor countries, especially in Africa. In these cases, of distant rural communities, the electricity generation by means of photovoltaic or wind systems is financially advantageous, relatively to transported electricity through standard networks.

The price competitiveness of diesel generators along with its high robustness and high quality standards has led these generators to the most used solution when remote sites needed to be fed with electric power. However, the continuous rise on fossil combustibles is bringing the renewable energy, mainly wind generators and solar photovoltaic panels, as interesting alternatives to diesel generators. Today we are facing a situation where the costs between several systems: wind, photovoltaic, diesel or even a PV-Wind-Diesel hybrid solution, are very close and the development of a systematic methodology is needed to take a sound decision on the investment.

A correctly designed photovoltaic-wind-diesel hybrid system enlarges considerably both the diesel generator lifecycle as well as the batteries lifecycle, when referring to the widespread off-grid generator systems. Both benefits need to be correctly accounted in the evaluation process, as maintenance costs are reduced significantly in the case of a PV-wind-Diesel solution.

In this context, the design of hybrid systems is a relevant issue. An ideal system has to supply, at any given time of the month, an instantaneous energy E_S that equals the consumed energy by all system loads E_L .

$$E_S = E_L \quad (1)$$

A sub-sized system obviously doesn't satisfy the demand on electric power and, on the other hand, a over-sized system can be completely prohibitive due to economical and financial indicators [1], [2]. This paper aims to develop a new method to evaluate the design of a PV-Wind-Diesel Hybrid System for electricity production. The different types of renewable sources are specifically evaluated in the economical performance of the overall equipment. The presented methodology was applied to evaluate the design of a PV-wind-diesel hybrid system to produce electricity for a community in the neighbourhood of Luanda, Angola.

2. Methodology Description

Before we begin the design of a PV-wind-diesel hybrid system we need to know the following main available natural resources: wind profile and solar radiation. In case we have suitable amplitudes of both renewable energetic sources we can actually initiate the design of the hybrid system. First of all we need to calculate the dimension of the following elements: PV-system, wind-generator, diesel

generator, CC-CA converter and battery set. Following the work from Celik [2], we propose the following methodology:

- 1) Calculate the PV-area and the wind-area needed for each month, covering the monthly demand on electric power. Then proceed with the calculation of the equipment size, taking into account the 12-months average - A_{PV} and A_W - (eqs. 2, 3) and the correspondent standard deviations (σ_{PV} e σ_W). This statistical analysis is based on the probability density associated with each natural resource.

$$A_{FV} = \frac{E_S}{e_{FV}} \quad (2)$$

$$A_{FV} = \frac{E_S}{e_A} \quad (3)$$

where:

E_S : Total energy supplied by the Hybrid System [kWh]

e_{PV} : specific PV-energy [kWh/m²]

e_W : specific wind-energy [kWh/m²]

- 2) Resize the calculated dimension A_{PV} and A_W using a factor dependent on σ_{PV} and σ_W , respectively.
- 3) Calculate the number of standard PV-models and wind-generators according to the market availability, dividing the total power calculated by the standard power unit available in the market.
- 4) Calculate the life-cycle costs associated with different percentages of PV-wind composition, and optimize this cost function. The optimal Hybrid system design corresponds to the minimization of the cost function (fig. 1).

Referring now to the evaluation of the output power that the hybrid system should deliver, this methodology accounts for the following factors:

- 1) all known electric power needs (loads) have to be considered;
- 2) power losses in the distribution network and in the inverter system are considered;
- 3) the technical data supplied by PV-producers and wind-generator producers as well as the site measurements of wind profile and solar radiation are the basis for the PV and wind specific energy determination;
- 4) The maximum of the power load curve, added to the calculated losses in the system, determines the size of: the generator group, the power module, and the converter DC-AC.
- 5) Finally the battery set is designed according to the autonomy required to the projected Hybrid system. The integration of the power load curve for the projected autonomy time-period gives the net output supply for the battery set.

The determination of the optimal composition PV-Wind Hybrid system is made through the fraction variation PV-Wind, regarding the Project associated costs with each configuration [4], [5]. The optimal PV-Wind configuration, for a specific site, corresponds to the minimum Project cost as illustrated in figure 1.

This methodology was applied to design a photovoltaic-wind-diesel hybrid system to produce electricity for a community in the neighbourhood of Luanda, Angola.

The resulted net energy costs were very satisfactory regarding the economical possibilities of these African communities.

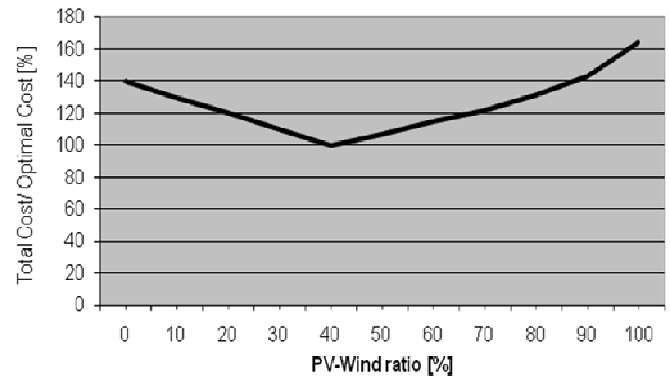


Fig. 1. Costs associated with different PV-Wind combinations

3. Case study

A. Description

This study was made in a community near by Luanda, in Angola. This community like many others in Angola doesn't have any energy supply provided by a dealership, thus have to use individual generators, mostly diesel ones. It was made a survey to identify the installed loads, likewise a calculation of the load to be installed, as this study of electric energy supply through a mini-net, will have as its purpose to supply electric energy to a duelling set which doesn't have its own energy production and will be connected to this mini-net. It was also made a local natural resources survey to analyse potential energetic gains. It was proved a good solar potential and a good wind potential due to the fact that this community is located in a coastal site.

B. Evaluation of Energy Demand

Once some of the dwellings of this small community already have its own electric energy production through generators, in the energetic needs survey, this production was counted. The features of the individual electric energy production supplied by existing generators in this community are shown on table 1. On this table we can see that 10 generators are working, mainly diesel supplied. Table 1 contents were collected through individual interviews to the local owners.

Home n.	Installed Power (kW)	Mean Consumption/month (kWh/month)
1	0,7	70
2	0,8	95
3	0,9	160
4	1,5	145
5	1,5	150
6	3,0	350
7	2,0	200
8	0,9	140
9	0,8	50
10	1,4	90
Total	13,5	1450

Home n.	Generator Power (kVA)	Fuel	Mean Fuel Consumption/month (l/month)
1	3	Diesel	65
2	4	Gas	50
3	4	Diesel	110
4	7,5	Diesel	100
5	7,5	Diesel	100
6	7,5	Diesel	130
7	6	Diesel	120
8	5	Diesel	90
9	3	Diesel	50
10	4	Diesel	60
Total	51,5	-	875

Table 1 - Energy production generated by generator-sets

In figure 2, it is shown the daily electric energy consumption. The data was collected through individual interviews to local owners. This community shows typical features of rural environments relatively to the use and consumption of electric energy.

Based on the local owner interviews it was estimated a monthly consumption of 145 kWh/month, for each one of the future 15 dwellings, that will be connected to the mini-network. This estimate leads to a daily consumption of 2,9 kWh/day, with a small consumption over day, between 6 AM and 5 PM and with a night spike between 5 PM and 0 AM.

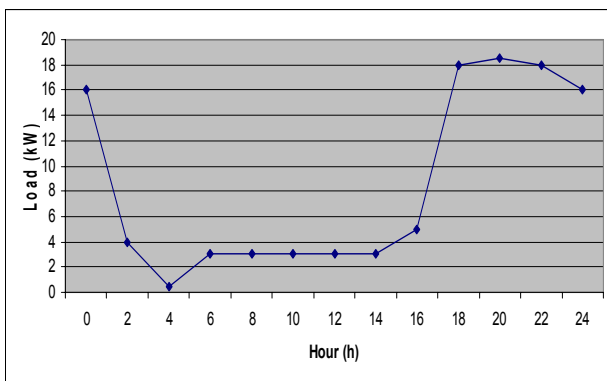


Fig. 2 – Daily electric energy consumption

C. Evaluation of Energetic Sources

Photovoltaic Energy

The survey on the solar potential of the community was made through the data acquisition by a solar-meter station installed on the site. The data were obtained in an hourly basis. Figure 3 shows the monthly average daily radiation, in the year 2007, on a plane at an angle of 30° in relation to the horizontal position, towards south. The average daily radiation in the year 2007 was 4,75 kWh/m².

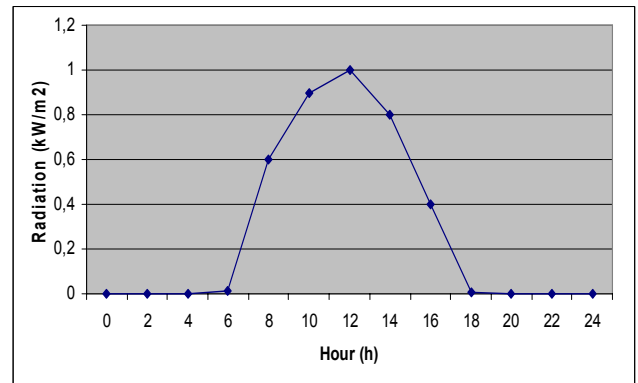


Fig.3 – Monthly average of daily radiation

Finally, to design the PV-unit we have to consider additionally, that the PV-cell performance depends on the solar radiation, on the temperature, on the tension and on the dirt located on the panel surface.

Wind Energy

The wind resources' survey was based mainly on experimental data acquired through a 30m-tower equipped with an anemometer. Figure 4 shows the monthly average wind speed at a height of 30m, in the year 2007.

The average wind speed registered shows a value of 4,1 m/s, for the year 2007. Another important data to evaluate the wind potential is the rate of the registered wind speed's occurrences. Figure 5 shows the histogram registered in 2007, correspondent to a 30m height.

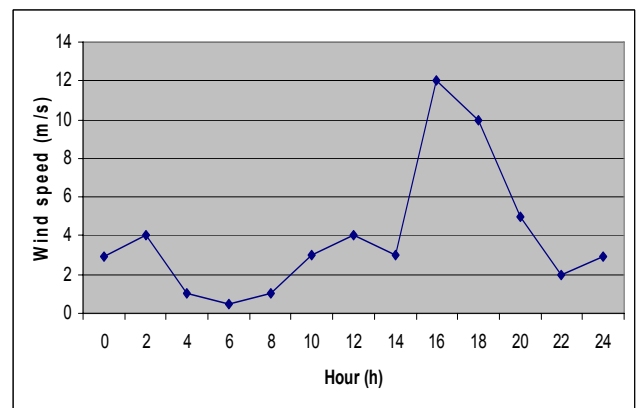


Fig.4. Monthly average of Wind speed

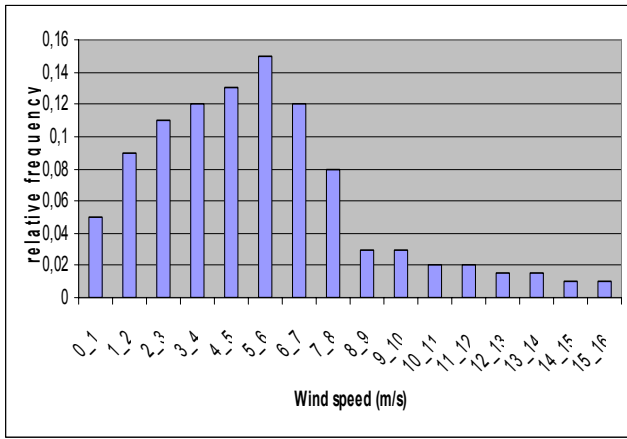


Fig. 5 Wind histogram - 2007

With the final purpose of getting an estimated wind potential at different heights it was calculated the local roughness factor. Evaluating the terrain and the preponderance of the wind's incidence, it was possible to determinate the local roughness using equation 4.

$$v(z) = v_r \left(\frac{z}{z_r} \right)^\alpha \quad (4)$$

Where $v(z)$ is the speed at a z height, v_r is the speed at a reference height z_r and the parameter α is dependent on the local terrain roughness.

After the site evaluation had been made, the terrain features were observed. These main features are: mountainous, open sea and medium size vegetation. The distance between the tower and the open sea is about 500 meters. Additionally on this part of the site there is some small vegetation and small sand-hills. Figure 6 characterizes the wind geographical distribution with the rates correspondent to 30m height.

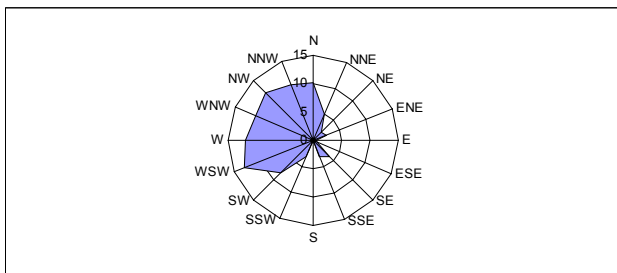


Fig. 6. Rates of wind occurrence

The calculated roughness factor is 0,35 for the predominant wind region.

A survey on the performance of typical available small sized turbines, at a 50m-height, is illustrated on table 2. This data shows a significant improvement on the equipment efficiency when we increase the height from 30m to 50m. This reason explains why we verify that the usual wind-turbines are found to be installed at a 50m height.

At a 50m height the ratio EAW/EIWE (EAW = Expected Available Wind Energy; IWE = Installed Wind Energy) has a typical improvement of ca. 20% [6].

Wind Generator	Power (kW)	EAW/EIWE (30 m)	EAW/EIWE (50 m)
Westwind	5	15	20
Westwind	10	12	18
Westwind	20	13	22

Table 2 - EAW/EIWE [6]

D. System Design

Besides the components dimensioning, based on data evaluation, it's also important to take into account some features of the local resources available in the site. Figure 7 and figure 8 represent the assumed annual power profile for both PV and wind resources. A quick analysis of these data permits to observe that there isn't any seasonal complementarity between the solar and the wind resources. However, there is a daily complementarity between solar and wind resources as it is shown in figs. 7 and 8. This fact contributes to a better utilization of the available resources.

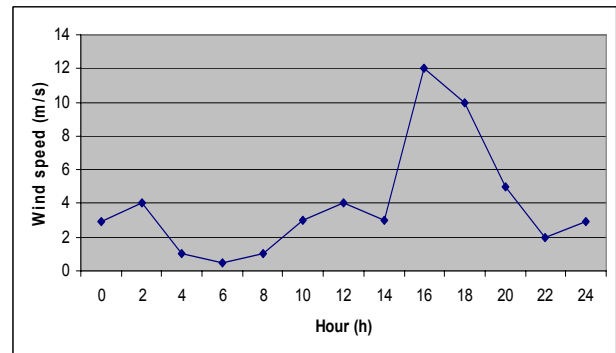


Fig.7. Annual power profile: wind resources (assumed profile)

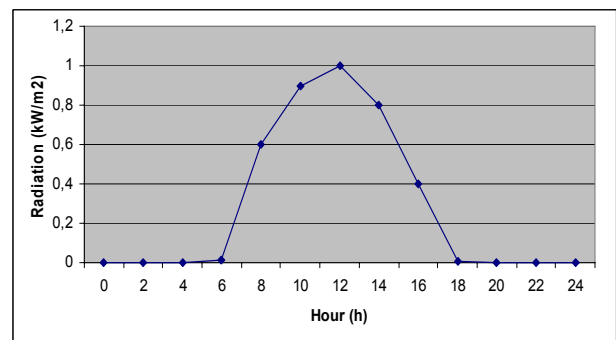


Fig. 8. Annual power profile: PV resources (assumed profile)

Having now the data that characterizes both the energy demand (loads) and the available renewable resources (data for PV and Wind) the hybrid system can now be completely designed.

For the PV-generator it was chosen the 85hp BP Solar panel [7]. In relation to the wind-generator, the 10kW Westwind turbine was selected [6].

Both equipments have shown the best technical features in relation to the studied local available resources.

Finally it was assumed a 5% losses in the chain distribution and a 90% conversion efficiency for the overall equipment.

Table 3 shows the necessary power surfaces for both PV and Wind generators independently, in order to supply the community monthly load.

Month	e_{PV} (kWh/m ²)	e_W (kWh/m ²)	E_L (kWh)
Jan	20,4	33,5	3447,3
Fev	21,2	25,3	3456,5
Mar	24,4	27,6	3233,2
Apr	19,6	22,2	3456,5
Mai	16,4	25,3	3456,5
Jun	17,2	21,2	3456,5
Jul	16,8	22,2	3447,4
Aug	15,6	14,6	3456,5
Set	16,4	14,6	3412,6
Out	18,8	25,3	3448,3
Nov	20,8	28,8	3456,5
Dez	20,8	33,5	3420,2

Month	APV (m ²)	AW (m ²)
Jan	169,0	102,9
Fev	163,0	136,8
Mar	132,5	117
Apr	176,3	156
Mai	210,8	136,8
Jun	201,0	157,6
Jul	205,2	155,6
Agu	221,6	236
Set	208,1	233
Out	183,4	136,4
Nov	166,2	120,2
Dec	164,4	102

Table 3 – Min. surfaces needed for PV and Wind generators, working independently

The PV-generator and the Wind-generator average areas are 183,5 m² and 149,2 m². The standard-deviations are 26,2 m² and 44,1 m² respectively. Adding the standard-deviation value to the correspondent average area we got the total area that best ensures the technical-economical relation, as it was described in section 2. These values for PV and Wind areas are independent quantities that can supply independently the total demanded energy. Finally the total area values are 209,7 m² and 193,3 m² for the PV-generator and for the Wind-generator respectively. Dividing these total values by the unitary performance values associated with the selected PV-panels and Wind-generators we get the max. number of PV-panels and Wind-generators.

For our case study, this methodology leads us to 233 PV-modules and 7 Wind generators.

Now to determine the optimal combination PV-Wind generators, for the designed hybrid system, we lead an

economical analysis.

The Net Present Value (NPV) methodology was used to perform the economical evaluation of the different analysed PV-Wind configurations.

Each studied PV-Wind configuration was evaluated over a life period of 20 years. The considered capital cost was 7% per year.

Figure 9 summarizes the results obtained in the developed NPV analysis. It is observed that the optimal operating point is obtained for a combination of ca. 40% Wind-generators (3 Wind turbines) and 60% of PV-generators (140 PV-panels).

Finally in order to assure 1-day energy autonomy, a battery set of 80 kWh, adjusted for a 50% maximum discharge depth, was considered.

The inverter and the generator group were designed to comply the maximal load which was under 20kW, according fig. 2.

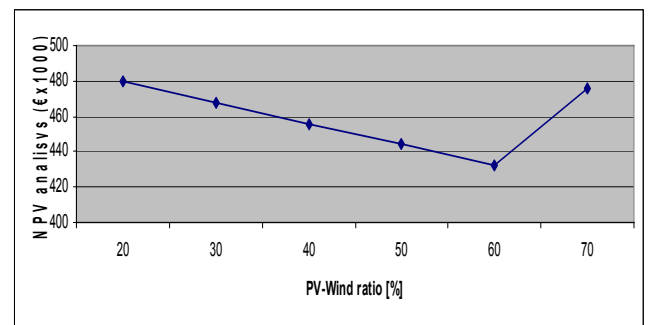


Fig. 9 – NPV analysis

4. Conclusions

This methodology had shown to be, both technical and economically, more advantageous than other project methods based on the data regarding the “worst month” scenario [3]. Since the “worst month” scenario methodology ignores the performance-cost relationship and it concentrates on the system performance alone, the obtained results can be misleading. The developed methodology has the advantage that it integrates all economical and financial factors, present in the project of electric energy delivery systems.

Acknowledgment

This work was partially funded by the FCT through program POCTI-SFA-10-46-IDMEC, subsidized by FEDER and by the Project PETER – PIC Interreg IIIA SP6.E53/03.

References

- [1] J. Gordon (Editor), “Solar Energy – The State of the Art”, ISES Position Papers, James & James, 2001.
- [2] Celik AN.; “Techno-economic analysis of autonomous pv-wind hybrid energy systems using different sizing methods”; Energy Conversion and Management, Vol. 44, 2003, Pages 1951-1968.
- [3] Protogeropoulos C, BriKworth BJ, Marshall R.; “Sizing and techno-economical optimization for hybrid solar pv-wind power systems with battery storage”. Int JEnergy Res 1997; 21:1-15.
- [4] Solarbuzz, “Solar Electricity Prices”, (<http://www.solarbuzz.com/SolarPrices.html>).
- [5] AWEA Wind Energy Fact Sheets, “The Economics of Wind Energy”, (<http://www.awea.org/pubs/factsheets.html>)
- [6] <http://www.westwind.com>
- [7] <http://www.bp.com>